

POWDER COAT
POLE & LUMINAIRE
FINISH COLOR PER PLAN

FIXTURE IS TO PROVIDE
DOWN LIGHTING RATHER
THAN GENERAL AREA
LIGHTING.


LIGHT TO BE:
25-45 WATT FLORESCENT
OR LED.

NOTES:

1. THE PHOTO CELL IS TO BE INSTALLED WITHIN THE ELECTRICAL SERVICE PANEL BOX UNDER A LEXAN WINDOW.
2. TIMERS TO BE INSTALLED INSIDE ELECTRICAL SERVICE PANEL.
3. FOR EACH LIGHTING SYSTEM INSTALL A PHOTO CELL OVERRIDE SWITCH FOR TESTING OF LIGHTS.

ROUND STEEL POLE
(14' UNLESS OTHERWISE
SPECIFIED)

BASECOVER
CONCRETE EXTENDED
4" ABOVE PAD.
BROOM FINISH.

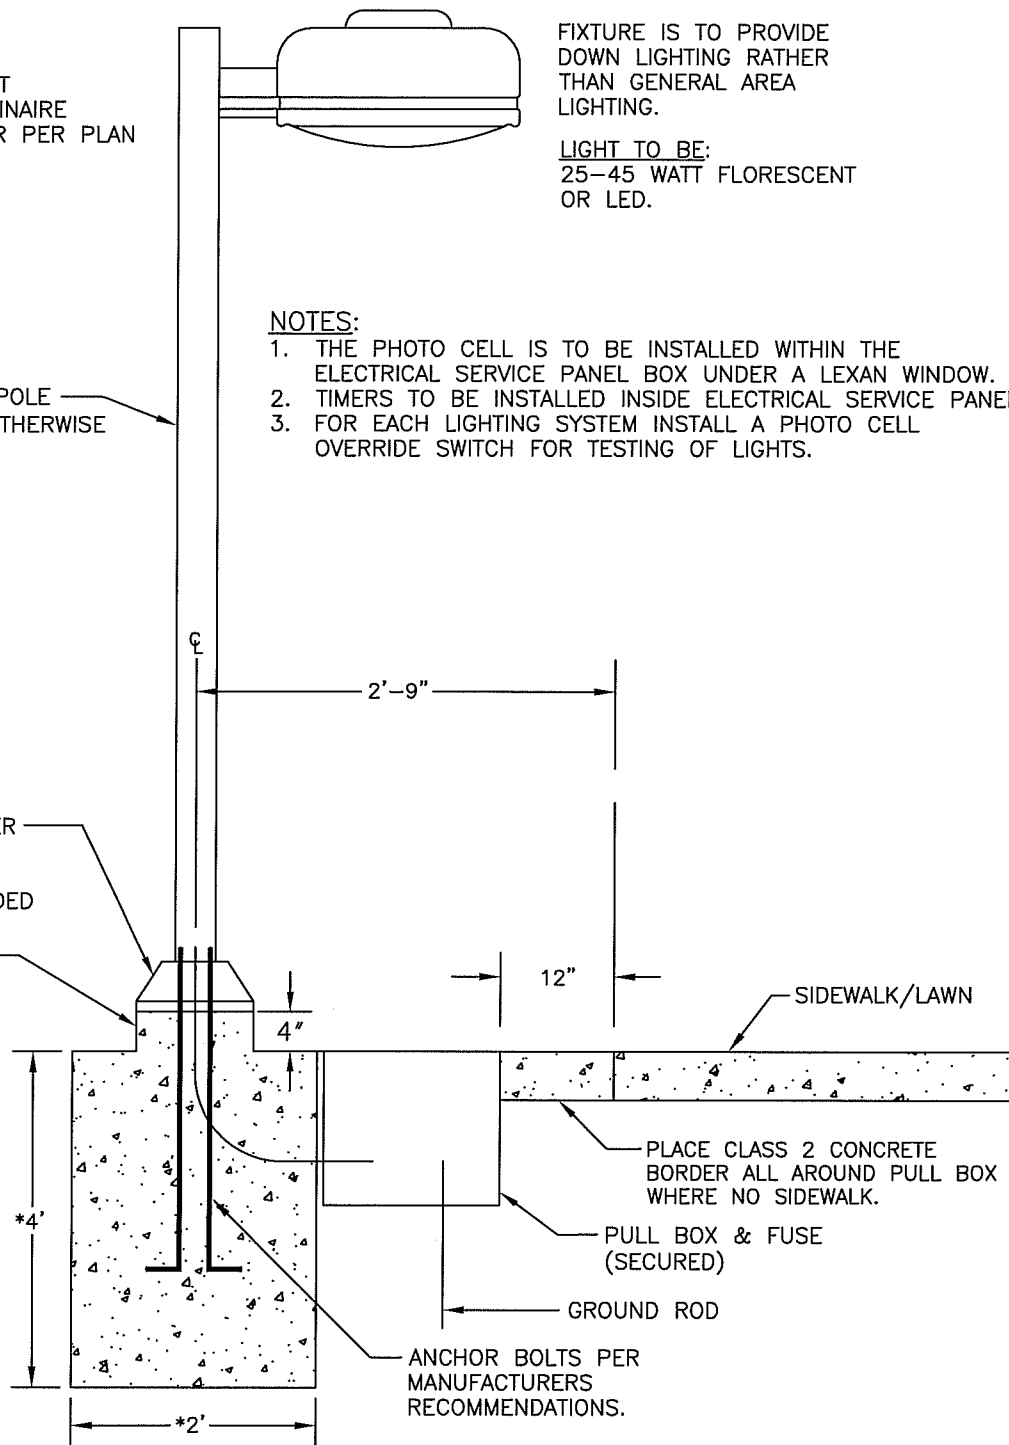

* DIMENSIONS ARE GENERAL AND MAY CHANGE PER MANUFACTURER'S
RECOMMENDATIONS, PLANS OR SPECS.



CITY OF CLOVIS

DWG NO.

P-23

PARK SECURITY LIGHT

REF.: STD. SPECIFICATIONS
SECTION 83 LIGHTING
SYSTEMS

APPROVED BY:	NO.	REVISED	BY	APPROVALS	SCALE: NTS
CITY ENGINEER		01-24-11	BGJ	CM	DRAWN BY: JA
		02-16-11	BGJ	DRU PUD	SHEET 1 OF 1
DATE: 9/19/11				OTHER	