


TEMPORARY INLET

TEMPORARY BASIN OUTLET

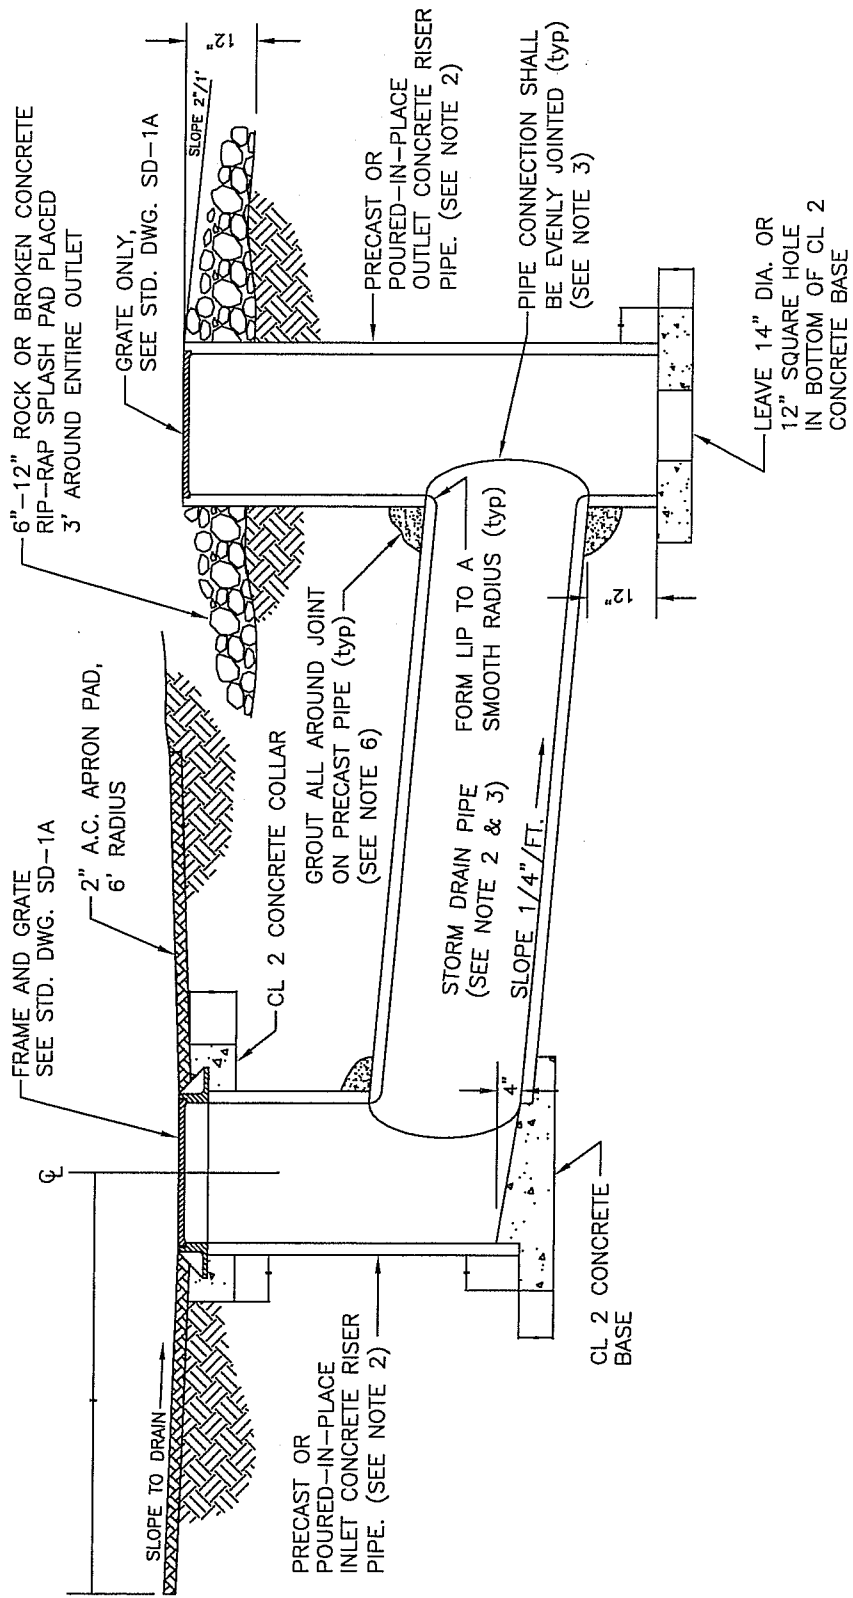

NOTES:

1. PRECAST CONCRETE RISER PIPE SHALL CONFORM TO A.S.T.M. DESIGNATION C 118. CONCRETE FOR CAST-IN-PLACE SHALL BE CL 2.
2. RISER AND CONNECTOR PIPE SHALL BE 24" DIAM. MIN. UNLESS OTHERWISE NOTED ON THE PLANS.
3. STORM DRAIN PIPE SHALL BE CL III RCP NEATLY CUT AS NECESSARY TO FORM AN EVEN CONNECTION WITH RISER PIPE. IN ADDITION, THE LIP OF THE STORM DRAIN PIPE SHALL BE SMOOTHLY ROUNDED TO AN APPROX. 3" RADIUS ALL AROUND.
4. BASE FOR 24" RISER PIPE SHALL BE CLASS 2 CONCRETE.
5. INLET FLOOR SHALL SLOPE FROM ALL WALLS TO THE FLOWLINE AND SHALL BE GIVEN A STEEL-TROWELED FINISH.
6. CONNECTION JOINT BETWEEN STORM DRAIN PIPE AND RISER PIPE SHALL BE FILLED AND COLLARED WITH MORTAR OR CONCRETE.
7. SEE STD. DWG. SD-1A FOR FRAME AND GRATE DETAILS.
8. FOR CROSS DRAIN APPLICATIONS, USE INLET ON BOTH ENDS. CONNECTOR PIPE SHALL SLOPE 1/4"/FT TO DESIGNATED INLET.



CITY OF CLOVIS

TEMPORARY DRAINAGE  
INLET AND BASIN OUTLET

DWG NO.  
**SD-1**

REF: STD. SPECIFICATIONS  
SECTION 63

APPROVED BY:  CITY ENGINEER	NO.	REVISED	BY	APPROVALS	SCALE: NTS
		03-13-09	BGJ	CM <i>dec</i> DRU <i>mal</i> PUD <i>dk</i>	DRAWN BY: BGJ
DATE: 6/29/09					SHEET 1 OF 1