


PLAN VIEW - FIRE HYDRANT

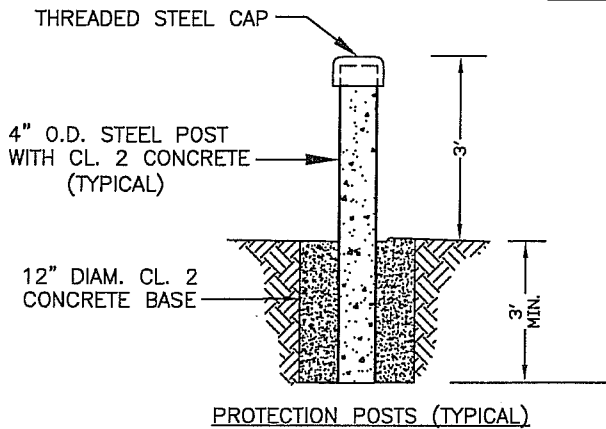

PROTECTION POSTS (TYPICAL)

NOTES:

1. PROTECTION POST SHALL BE REQUIRED ON ALL FIRE HYDRANTS THAT ARE LOCATED IN OR ADJACENT TO DRIVEWAYS, PRIVATE ROADS, ALLEYS OR PARKING LOTS WHERE THERE IS NO CURB PROTECTION OR NATURAL PROTECTION, AND WHERE DEEMED NECESSARY BY THE FIRE DEPARTMENT, PUBLIC UTILITIES DEPARTMENT OR WHERE FIRE HYDRANTS ARE CONTINUOUSLY BEING DAMAGED BY VEHICLES.
2. IF GALVANIZED POST AND CAPS ARE NOT USED, THEY SHALL BE PAINTED WITH 2 COATS OF RUST PRIMER FOLLOWED BY 2 COATS OF RUSTOLEUM SAFETY YELLOW PAINT.
3. FOR ALL HYDRANTS, THE 4.5" OUTLET SHALL FACE THE STREET, OR FACE THE ACCESS WAY FOR INTERIOR INSTALLATIONS.



# CITY OF CLOVIS

DWG NO.  
**W-3**

## FIRE HYDRANT PROTECTION POSTS

REF. STD. SPECIFICATIONS  
SECTION 66

APPROVED BY:	NO.	REVISED	BY	APPROVALS	SCALE: NTS
CITY ENGINEER		02-25-09	BGJ	CM <i>JRL</i> DRU <i>MAI</i> PUD <i>OK</i>	DRAWN BY: JA
	DATE: 1/20/10			FIRE <i>16CH</i>	SHEET 1 OF 1