


NOTES:

1. ALL ABOVE GRADE RECYCLED WATER PIPING AND/OR PLUMBING APPURTENANCES SHALL BE COLORED PURPLE.
2. ANY PROPERTY WHERE RECYCLED WATER IS USED SHALL HAVE AN APPROVED BACKFLOW DEVICE INSTALLED ON THE POTABLE WATER SERVICE.
3. ALL BURIED PIPING SUPPLIED WITH RECYCLED WATER AND CONTINUOUSLY UNDER PRESSURE SHALL BE MARKED WITH PURPLE WARNING TAPE OR WITH STENCILED LETTERING TO IDENTIFY IT AS CARRYING RECYCLED WATER PER TITLE 22 REGULATION.
4. FOR RECYCLED AND POTABLE WATER METER BOX SIZES, SEE APPLICABLE WATER STD. DRAWINGS FOR SPECIFIED SERVICE SIZE AND TYPE.
5. INSTALL PIPE SUPPORT DOWN STREAM OF BACKFLOW DEVICE ON 2" OR LARGER.



①	VICTAULIC STYLE 78 SNAP-JOINT COUPLINGS OR APPROVED EQUAL COUPLINGS ARE TO BE DESIGNED FOR QUICK DISCONNECT SERVICE.	CLOSED
		FULLY EXTENDED
②	VICTAULIC NO. 10 90° ELBOWS OR APPROVED EQUAL FITTINGS ARE TO BE SUPPLIED WITH GROOVES OR SHOULDERS TO PERMIT FAST INSTALLATION WITHOUT FIELD PREPARATION. THE GROOVED DESIGN PERMITS FLEXIBILITY FOR EASY ALIGNMENT.	

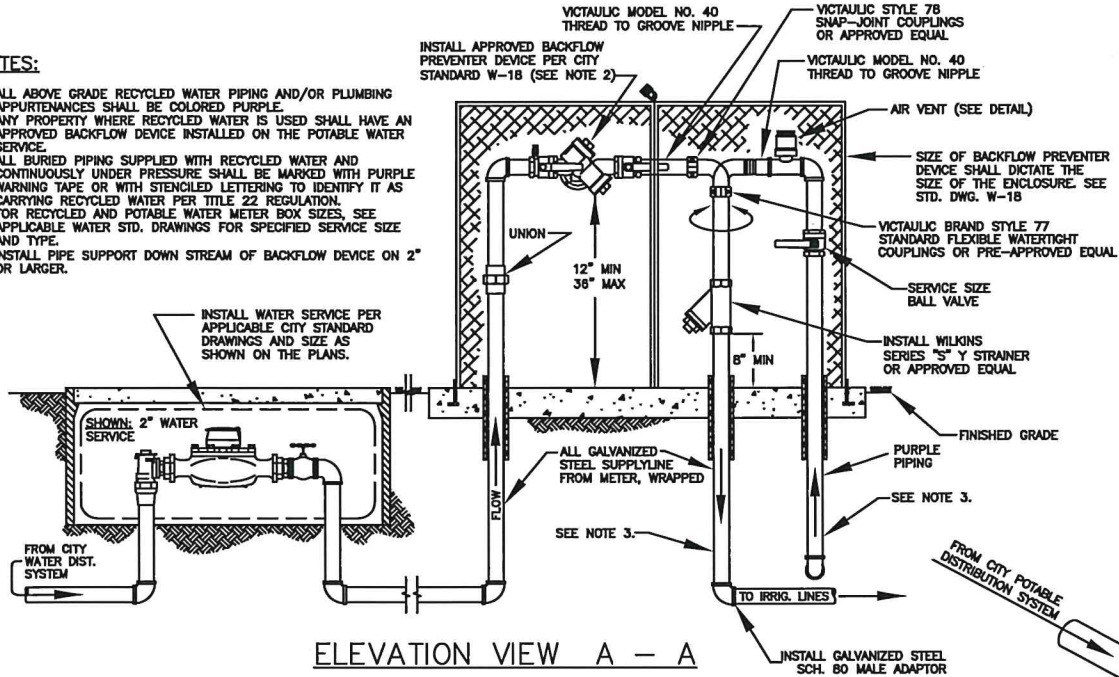

CITY OF CLOVIS

DWG NO. **RW-1**

RECYCLED WATER PIPING WITH SWIVEL JOINT CONNECTION

REF: STD. SPECIFICATIONS SECTION 67

APPROVED BY:

CITY ENGINEER
DATE: 1/16/2020

NO.	REVISED	BY	APPROVALS
	03-13-09	BGJ	CM
	05-16-12	BGJ	DRU
2	07-25-19	CGV	PUD

SCALE: NTS
DRAWN BY: BGJ
SHEET 1 OF 1