


NOTES:

1. ALL ABOVE GRADE RECYCLED WATER PIPING AND/OR PLUMBING APPURTENANCES SHALL BE COLORED PURPLE.
2. ANY PROPERTY WHERE RECYCLED WATER IS USED SHALL HAVE AN APPROVED BACKFLOW DEVICE INSTALLED ON THE POTABLE WATER SERVICE.
3. ALL BURIED PIPING SUPPLIED WITH RECYCLED WATER AND CONTINUOUSLY UNDER PRESSURE SHALL BE MARKED WITH PURPLE WARNING TAPE OR WITH STENCILED LETTERING TO IDENTIFY IT AS CARRYING RECYCLED WATER PER TITLE 22 REGULATION.
4. FOR RECYCLED AND POTABLE WATER METER BOX SIZES, SEE APPLICABLE WATER STD. DRAWINGS FOR SPECIFIED SERVICE SIZE AND TYPE.
5. INSTALL PIPE SUPPORT DOWN STREAM OF BACKFLOW DEVICE ON 2" OR LARGER.



①	VICTAULIC STYLE 78 SNAP-JOINT COUPLINGS OR APPROVED EQUAL. COUPLINGS ARE TO BE DESIGNED FOR QUICK DISCONNECT SERVICE.	
②	VICTAULIC NO. 10 90° ELBOWS OR APPROVED EQUAL FITTINGS ARE TO BE SUPPLIED WITH GROOVES OR SHOULDERS TO PERMIT FAST INSTALLATION WITHOUT FIELD PREPARATION. THE GROOVED DESIGN PERMITS FLEXIBILITY FOR EASY ALIGNMENT.	

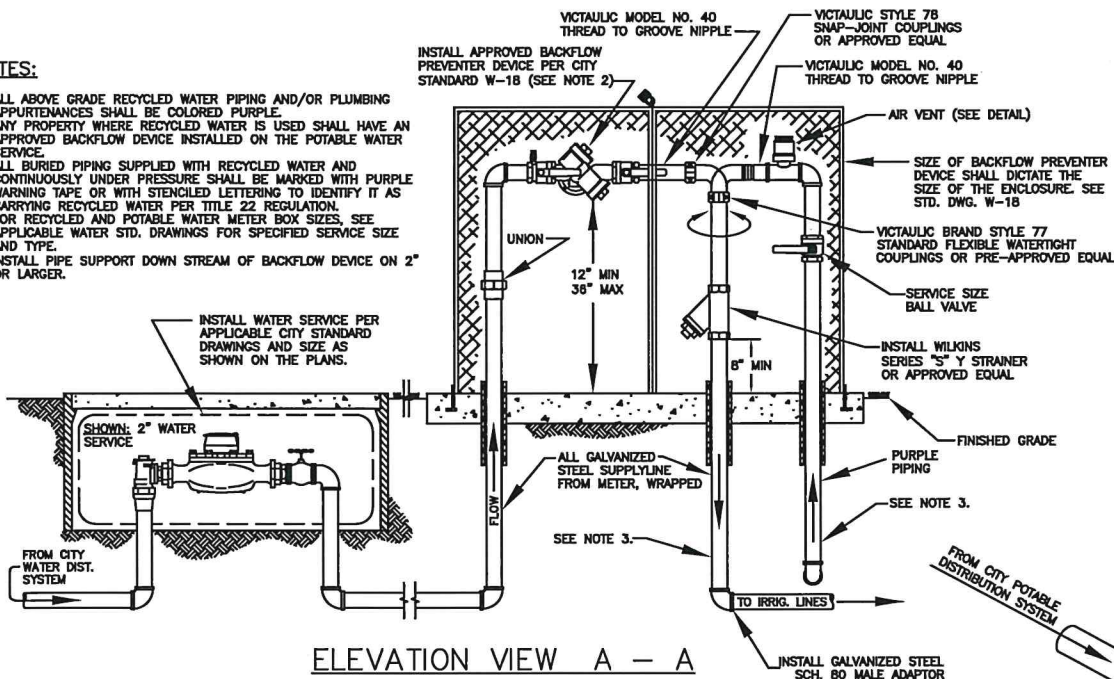

CITY OF CLOVIS

RECYCLED WATER PIPING WITH SWIVEL JOINT CONNECTION

DWG NO.

RW-1

REF: STD. SPECIFICATIONS
SECTION 67

SCALE: NTS

DRAWN BY: BGJ

SHEET 1 OF 1

APPROVED BY:

[Signature]

CITY ENGINEER

DATE: 1/16/2020

NO.

REVISED

BY

APPROVALS

03-13-09

BGJ

CM

DRU

PUD


05-16-12

BGJ

07-25-19

CGV

2

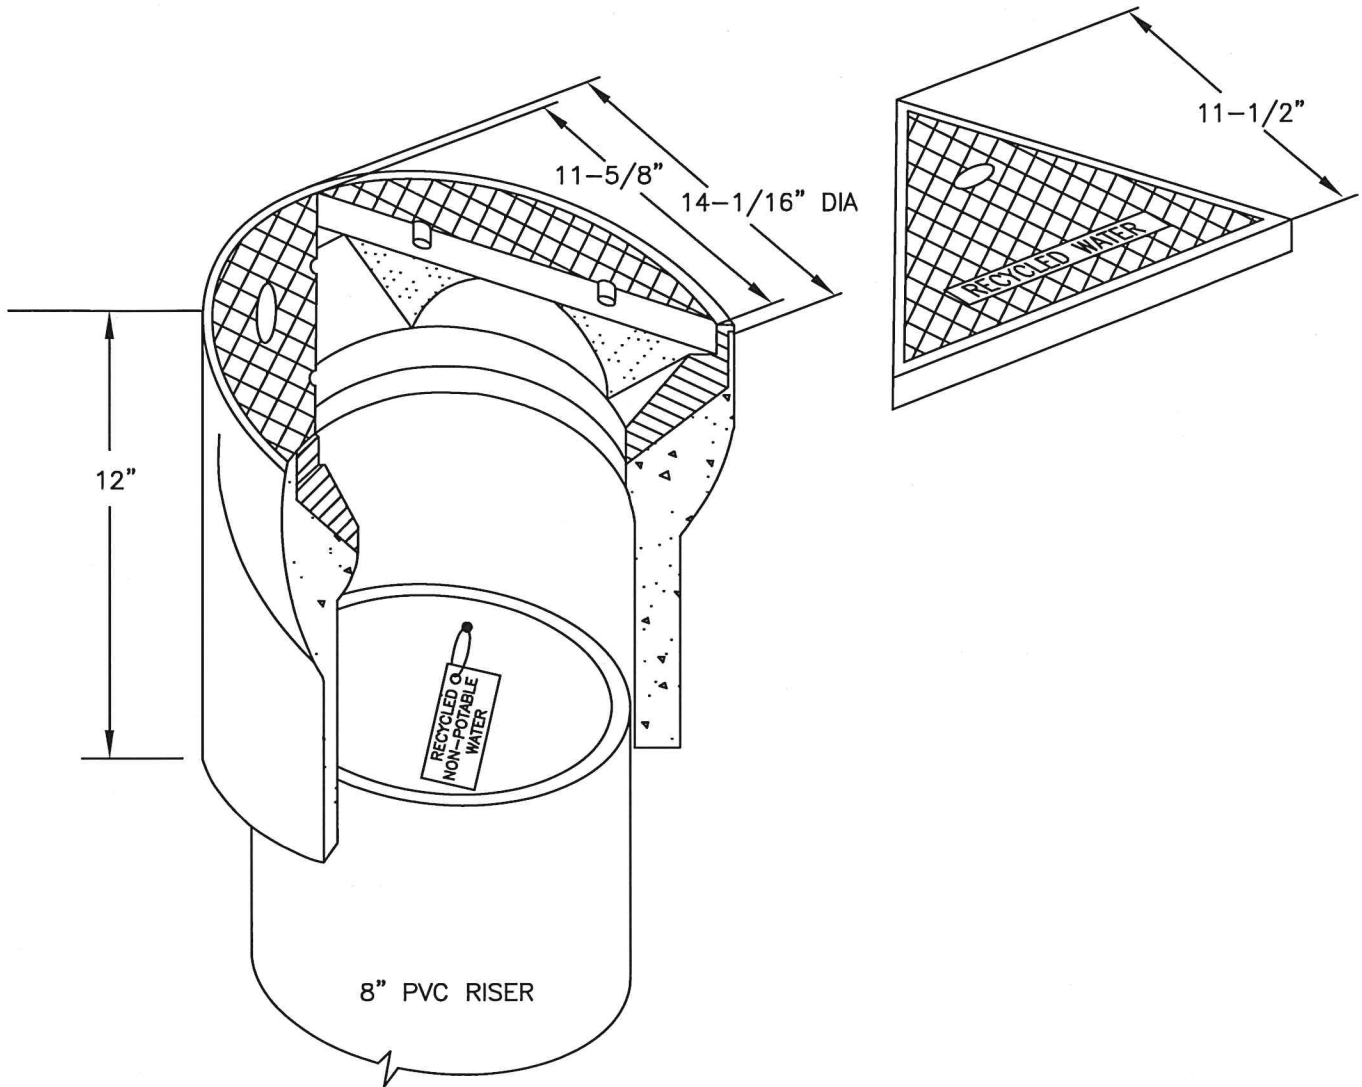

NOTES:

1. VALVE BOX SHALL BE CHRISTY MODEL G04BOX TRAFFIC VALVE BOX (10" I.D. X 12" HIGH) OR APPROVED EQUAL.
2. VALVE BOX LID SHALL BE CHRISTY MODEL G04C, CAST IRON, OR APPROVED EQUAL. THE WORDS "RECYCLED WATER" SHALL BE STAMPED OR CAST, OR HARDFACE WELDED ONTO LID.
3. ALL OTHER ASPECTS OF THE BOX, INCLUDING CONCRETE COLLAR, RISER, AND TRACER WIRE SHALL CONFORM TO STANDARD DRAWING W-1, "WATER VALVE."
4. HANG 2"X4" METAL TAG LABELED "RECYCLED, NON-POTABLE WATER" NEAR THE TOP OF THE PVC RISER.



CITY OF CLOVIS

RECYCLED WATER VALVE BOX

DWG NO.

RW-2

REF: STD. SPECIFICATIONS
SECTION 67

APPROVED BY:

[Signature]

CITY ENGINEER

DATE: 1/16/2020

NO.

REVISED

BY

APPROVALS

06-10-09

BGJ

CM

DRU

PUD

08-18-09

BGJ


07-25-19

CGV

SCALE: NTS

DRAWN BY: BGJ

SHEET 1 OF 1

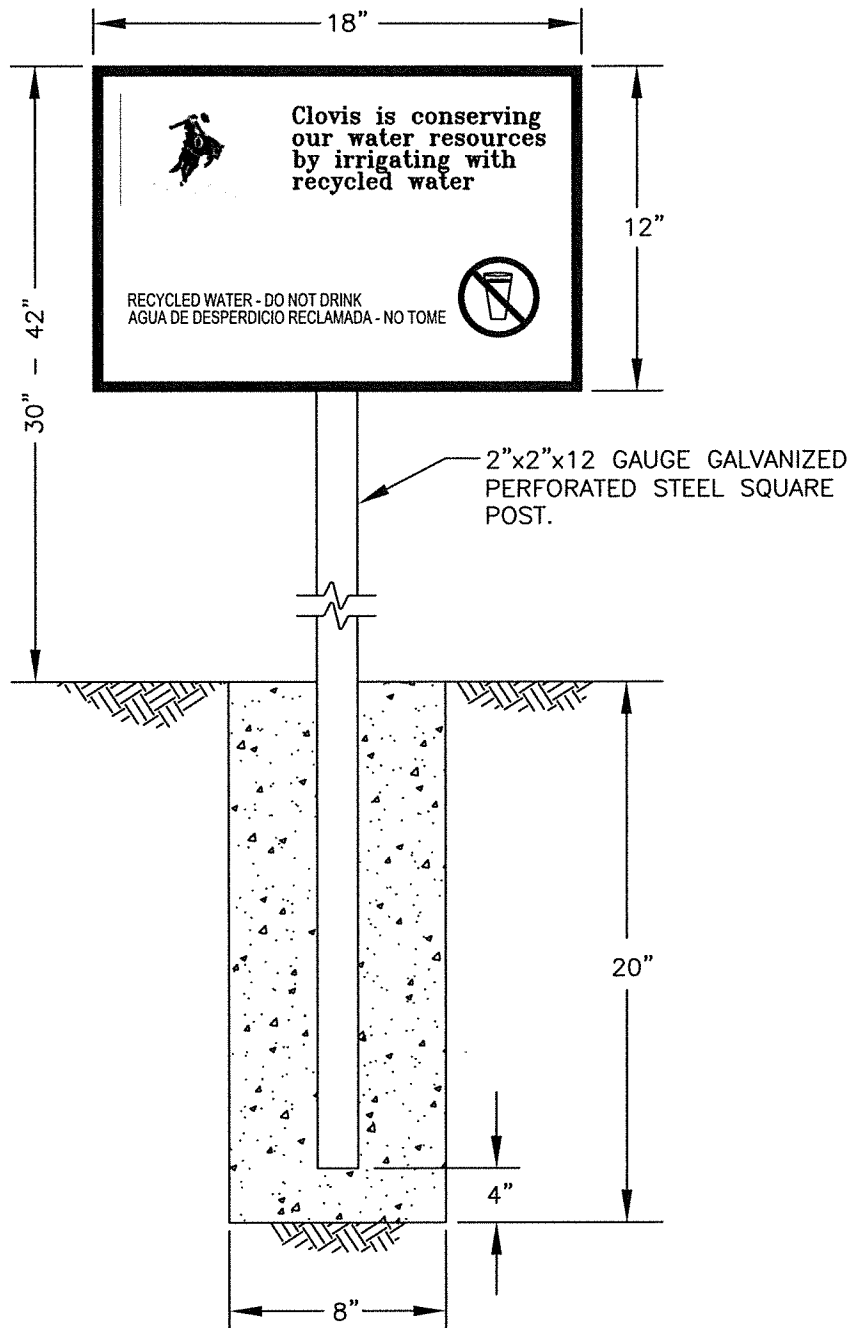

NOTES:

1. ALL USE AREAS WHERE RECYCLED WATER IS USED THAT ARE ACCESSIBLE TO THE PUBLIC SHALL BE POSTED WITH ONE OR MORE INFORMATION SIGNS IN CONSPICUOUS LOCATIONS THAT ARE VISIBLE TO THE PUBLIC.
2. INFORMATION SIGNS SHALL BE CONSTRUCTED OF 0.080" THICK ALUMINUM REFLECTIVE SHEETING WITH A PURPLE BACKGROUND AND WHITE LETTERING AND A 3M#1160 GRAFFITI FILM APPLIED, OR APPROVED EQUAL.
3. LOCATION OF SIGN AT EACH RECYCLED WATER SERVICE TO BE DETERMINED BY THE ENGINEER.

	CITY OF CLOVIS					DWG NO. RW-3
	RECYCLED WATER ID SIGN 18"X12"					REF: STD. SPECIFICATIONS
APPROVED BY:	NO.	REVISED	BY	APPROVALS	SCALE: NTS	
CITY ENGINEER DATE: 10/22/15		06-16-09	BGJ	CM DRU PUD	DRAWN BY: BGJ	
		05-29-12	PAA		SHEET 1 OF 1	
		10-27-15	CGV			